

This is the peer reviewed version of the following article:

Control of Legionella contamination and risk of corrosion in hospital water networks following various disinfection procedures / Marchesi, Isabella; Ferranti, Greta; Mansi, Antonella; Marcelloni, Anna M; Proietto, Anna R; Saini, Navneet; Borella, Paola; Bargellini, Annalisa. - In: APPLIED AND ENVIRONMENTAL MICROBIOLOGY. - ISSN 0099-2240. - STAMPA. - 82 (10):(2016), pp. 2959-2965. [10.1128/AEM.03873-15]

*Terms of use:*

The terms and conditions for the reuse of this version of the manuscript are specified in the publishing policy. For all terms of use and more information see the publisher's website.

15/04/2024 12:03

(Article begins on next page)

1 Control of *Legionella* contamination and risk of corrosion following various disinfecting procedures in  
2 hospital water networks

3

4 Isabella Marchesi,<sup>a</sup># Greta Ferranti,<sup>a</sup> Antonella Mansi,<sup>b</sup> Anna M. Marcelloni,<sup>b</sup> Anna R. Proietto,<sup>b</sup>  
5 Navneet Saini,<sup>a</sup> Paola Borella,<sup>a</sup> Annalisa Bargellini<sup>a</sup>

6

7 University of Modena and Reggio Emilia, Department of Biomedical, Metabolic and Neurosciences,  
8 Section of Public Health, Modena, Italy <sup>a</sup>; INAIL Research Area, Department of Occupational and  
9 Environmental Medicine, Epidemiology and Hygiene, Monte Porzio Catone, Rome, Italy<sup>b</sup>

10

11 Running title: *Legionella* and corrosion following disinfection

12

13 #Address correspondence to Isabella Marchesi, [isabella.marchesi@unimore.it](mailto:isabella.marchesi@unimore.it)

14

15 ABSTRACT

16 Physical and chemical disinfection methods have been proposed with the aim of controlling *Legionella*  
17 water contamination. To date, the most effective procedures for reducing bacterial contamination have  
18 not yet been defined. The aim of this study is to assess the long-term effectiveness of various  
19 disinfection procedures in order to reduce both culturable and **not culturable (NC)** legionellae in  
20 different hospital water networks treated with heat, chlorine dioxide, monochloramine and hydrogen  
21 peroxide. The temperature levels and the biocide concentrations that proved to obtain reliable results  
22 were analysed. In order to study the possible effects on the water pipes, we verified the extent of  
23 corrosion on experimental coupons after applying each method for six months. The percentage of  
24 positive points was at its lowest after treatment with monochloramine, followed by chlorine dioxide,

25 hydrogen peroxide and hyperthermia. A different selection of *Legionella* spp was observed, as  
26 networks treated with chlorine-based disinfectants were mainly contaminated by *L. pneumophila*  
27 serogroup 1, hyperthermia was associated with the serogroups 2-14 and hydrogen peroxide mainly with  
28 non-*pneumophila* species. NC cells were only detected in heat-treated waters, also when the  
29 temperature was approximately 60°C. The corrosion rate of the coupons was within a satisfactory limit  
30 for water networks, but the morphology changed. We confirm that chemical disinfection controls  
31 *Legionella* colonization more effectively than hyperthermia. Monochloramine was the most effective  
32 treatment, while hydrogen peroxide could be a promising alternative to chlorine-based disinfectants  
33 due to its ability to select for other less virulent or non-pathogenic species.

34

## 35 INTRODUCTION

36 The number of cases of Legionnaires' disease has increased steadily over the years especially in Italy  
37 and Europe (1, 2). In 2013 in Italy, most cases were community-acquired (83.4%), followed by travel-  
38 associated (9.8%) and healthcare-associated (4.6%) (3). Despite the lower percentage of nosocomial  
39 cases, the control of *Legionella* spp contamination is essential in healthcare settings where patients, in  
40 particular those with compromised immune systems, are at high risk of contracting the disease with  
41 possible fatal outcome (4). For this reason, national and international guidelines recommend using  
42 preventive measures to control *Legionella* water contamination with particular reference to healthcare  
43 structures (3,5). A range of physical and chemical disinfection methods have been proposed, but to  
44 date, the most effective procedures for controlling contamination have not yet been defined (6).  
45 Moreover, their impact on pipe deterioration/corrosion has not been extensively documented and is  
46 mainly studied in models water distribution systems (7-10).  
47 Molecular investigation tools were used together with conventional culture for monitoring corrective  
48 actions (11-13). Culture is essential for identifying and typing the bacterial strains, however it is time

49 consuming and could give false negative results due to the possible presence of cells in a Viable But  
50 Not Culturable (VBNC) state (14). In the VBNC state, pathogens are not generally able to initiate  
51 disease, but virulence is retained, and infection can follow their resuscitation to the actively  
52 metabolizing state (15). Quantitative PCR (qPCR) techniques prove to have several advantages  
53 including high sensitivity, accuracy and rapid evaluation of germ contamination. The main  
54 disadvantage of these techniques is they that cannot distinguish viable and not viable cells which is an  
55 important factor to take into account when evaluating the effectiveness of corrective actions (16, 17). In  
56 order to overcome this problem, new PCR-based strategies, collectively called molecular viability  
57 analyses, have been developed (18). Among these, methods based on DNA-intercalating dyes such as  
58 ethidium monoazide (EMA) have been proposed together with qPCR (19-21). EMA selectively binds  
59 the DNA of cells with compromised membranes, while intact cell membrane represents a barrier for the  
60 dye. In this bound state, the DNA cannot be amplified by qPCR, while DNA from intact membrane  
61 cells can be amplified and quantified (21). The only insurmountable limitation of this method is the  
62 inability to detect bacteria inactivated by conditions that do not alter membrane permeability such as  
63 shortwave UV and low-temperature pasteurization (18).

64 The main aim of this study is to assess the long-term effectiveness of monochloramine, chlorine  
65 dioxide, hydrogen peroxide and heat in reducing/eliminating both culturable and **not culturable (NC)**  
66 legionellae in various hospital water networks. For this purpose, traditional culture was used with  
67 qPCR alone and in combination with EMA. In our study, the EMA-qPCR method proved to be suitable  
68 for measuring bacterial viability as oxidative disinfectants and heat rapidly act against bacterial cells  
69 **causing damage to cellular components including the cytoplasmic membrane** (18). In order to verify  
70 the possible corrosion action of each disinfection procedure, carbon-steel coupons were inserted along  
71 the water distribution systems, and were periodically examined for weight loss and morphology.

72

73 MATERIALS AND METHODS

74 Hospital setting

75 The study was carried out in two hospitals situated in Modena, northern Italy: a private hospital built in  
76 the 1980s, and an university hospital consisting of a central block indicated as building 1 and four  
77 separate blocks built between the 1970s and the 1990s. The same municipality provides the incoming  
78 cold groundwater in both hospitals. Hot water is produced *in situ* using heat exchangers and reaches the  
79 peripheral points through a water recirculation system. Three different water networks (A, B and C)  
80 distribute hot water in parallel in building 1, while the other four buildings of the university hospital  
81 have their own hot water network (D, E, F and G), as previously described (22). The private hospital  
82 has a unique hot water distribution network (H).

83 Since 2000, sampling plans have been implemented in order to assess *Legionella* spp contamination in  
84 the water distribution systems. In both hospitals, the samples collected prior to intervention were  
85 mainly contaminated by *L. pneumophila* serogroup 2-14 at concentrations higher than  $10^4$  CFU liter<sup>-1</sup>  
86 which led to the implementation of a wide range of control strategies (23). The disinfection strategies  
87 still operating in both hospitals are described below.

88 • University hospital, building 1 (nine-floors, 40 years old):

89 - a monochloramine device operating since March 2009 on water network C; monochloramine is  
90 produced in situ from the chemical reaction between a stabilized chlorine-based precursor and an  
91 ammonium salt (Sanipur S.r.l., Brescia, Italy). The monochloramine generator is set to maintain a  
92 concentration of biocide in the recirculation loop between 2.0 and 4.0 mg liter<sup>-1</sup>. Residual levels are  
93 in line with the guideline value of 3 mg liter<sup>-1</sup> and the maximum contaminant level of 4 mg liter<sup>-1</sup>,  
94 established by WHO and the United States Environmental Protection Agency (EPA), respectively  
95 (24, 25).

96 - two chlorine dioxide devices (Sanipur S.r.l., Brescia, Italy) operating since January 2005 on water  
97 network A and since November 2005 on water network B. Chlorine dioxide is produced in situ by  
98 injecting hydrochloric acid and sodium chlorite into the recirculating hot water. The system is set up  
99 to ensure concentrations of at least 0.30 mg liter<sup>-1</sup> at distal points as previously reported (22), without  
100 exceeding the EPA maximum residual disinfectant level of 0.80 mg liter<sup>-1</sup> (25).

101 • University hospital, building D (four-floors, 40 years old): an experimental hydrogen peroxide device  
102 operating since January 2012 (O2 S.r.l., Bergamo, Italy). 48% hydrogen peroxide solution is  
103 continuously injected into the recirculating hot water by a dosing pump in order to ensure  
104 concentrations of 15-20 mg liter<sup>-1</sup> at distal outlets.

105 • Private hospital H (four-floors, 35 years old): hyperthermia has been used since April 2012; the hot  
106 water is produced at a temperature of at least 60°C and distributed at temperatures constantly >50°C.

107

#### 108 Samples collection

109 Over a three-year period (January 2012 – December 2014), hot water samples (n. 662) were taken from  
110 heaters, return loops, and distal outlets (showers and/or taps) of the water networks treated with the  
111 disinfection strategies listed above. In both hospitals, the protocols anticipated sampling from at least  
112 one remote point every 50 beds, repeating sampling in the same sites every 3 or 4 months. The network  
113 that was experimentally treated with hydrogen peroxide was monitored more frequently: every week  
114 for the first three months, every month until the end of the second year and every 4 months during the  
115 last year. Water was collected in sterile plastic bottles without flaming and after flushing for 1 minute.  
116 Sodium thiosulphate (10 mg liter<sup>-1</sup>) was added (1 ml liter<sup>-1</sup>, final concentration) to neutralize residual  
117 free chlorine. At sampling, water temperature (digital thermometer), chlorine dioxide (DPD method,  
118 Microquant, Merck, Darmstadt, Germany), monochloramine (Indophenol method, Hach Lange, Milan,

119 Italy) and hydrogen peroxide (reflectometer RQflex 2, Merck, Darmstadt, Germany) were measured.  
120 The samples were returned to the laboratory immediately after collection and analysed within 24h as  
121 described elsewhere (26).

122

### 123 Laboratory methods

124 Culture and identification of *Legionella* spp were carried out with the ISO 11731:1998 method (27), as  
125 previously described (28). The results were expressed as CFU liter<sup>-1</sup>, and the limit of detection (LOD)  
126 of the procedure was 25 CFU liter<sup>-1</sup>.

127 DNA was extracted using the QIAamp DNAMini kit (Qiagen, Hilden, Germany), according to  
128 manufacturer's instructions as reported elsewhere (19). The extracted DNA was stored at -20°C until  
129 use.

130 The minimum number of samples, that were to be analysed by molecular methods in order to have  
131 statistical power, was determined by carrying out a power analysis based on the results of a previous  
132 pilot study (29). For each treatment, the first 22 negative samples with culture (total n. 88) were  
133 analysed by the qPCR with and without the EMA pre-treatment. The water samples were treated with  
134 EMA (Sigma Chemical Co., St Louis, MO, USA) at a final concentration of 6 µM (2.53 µg ml<sup>-1</sup>) prior  
135 to DNA extraction as reported by Mansi et al. (19).

136 The DNA amplification was carried out with a Rotor-Gene Q 2plex instrument (Qiagen, Hilden,  
137 Germany) using the commercial "New *Legionella* spp Quantitative kit" (Diatheva, Fano, Italy),  
138 validated in agreement to ISO/TS 12869:2012 (30, 31). The results were expressed as Genome Units  
139 per Liter (GU liter<sup>-1</sup>). Under the experimental conditions used in this study, the LOD and the limit of  
140 quantification of the qPCR method were estimated to be 100 GU liter<sup>-1</sup> and 500 GU liter<sup>-1</sup>,  
141 respectively.

142

143 Corrosion study

144 Rectangular coupons (area 21.81 cm<sup>2</sup>, density 7.87 g cm<sup>-3</sup>) of carbon steel C1010 foils with frosted  
145 surfaces were used for evaluating the type and extent of corrosion according to the standard practices  
146 ASTM G1-03:2011 and ASTM G4-01:2014 (32, 33). The non-alloy steel with carbon content up to  
147 0.22% is suitable for the conveyance of aqueous liquids, including water for human consumption (34).

148 We selected the C1010 steel with maximum carbon content of 0.13% because it is easily found in the  
149 market as coupons proper for our experimental conditions. The coupons were inserted into five  
150 separate racks made from polytetrafluoroethylene (see fig.1). The racks were connected to the return  
151 loops of the treated networks (A, B, D and H) and an untreated network (F). Before the beginning of  
152 the study, four coupons were inserted into each rack. After 2 and 4 months, one coupon from each rack  
153 was removed and a new coupon was added. After 6 months all the coupons were removed. In line with  
154 this practice, we analysed six coupons for each rack, two for each exposure time (2, 4, 6 months). After  
155 collecting the coupons for corrosion analysis they were immediately dried with dimethyl ketone and  
156 placed in vials containing silica gel for transportation to the laboratory. The weight loss method was  
157 used in order to determine the corrosion rate. The coupons were scraped with a brass brush to remove  
158 surface deposits, washed in an ultrasonic bath for 6 minutes and then weighted. The cleaning cycles  
159 were suspended as soon as weight value was stabilized. With the aim of determining the mass loss of  
160 the base metal when removing the corrosion products, an uncorroded control coupon was cleaned using  
161 the same procedure performed on the test coupons. The average corrosion rates were calculated by  
162 means of the following formula:

163 
$$\text{corrosion rate (mm y}^{-1}\text{)} = (K \times W) / (A \times T \times D)$$

164 where K, constant ( $3.65 \times 10^4$ ), W, mass loss (g), T, time of exposure (days), A, area (cm<sup>2</sup>) of carbon  
165 steel coupon, D, density (carbon steel)(g cm<sup>-3</sup>).



166 An optical microscope (Carl Zeiss, Milan, Italy) equipped with a system of automatic digitization of  
167 the images was used in order to characterize the corrosive phenomena.

168

169 Statistical analysis

170 All statistical analyses were performed with PASW statistic version 21.0 (SPSS Inc, Chicago, IL,  
171 USA). Logarithmic transformations were used to normalize the bacteriological data and the results are  
172 presented as geometric mean values. Chi-square test, paired t test, one-way analysis of variance  
173 (ANOVA) with Bonferroni test were applied whenever necessary.

174

175 RESULTS

176 In total, 237 out of 662 samples (35.8%) were contaminated by *Legionella* spp. The disinfection  
177 treatments significantly affected both the percentage of positive samples ( $\chi^2 = 104.385$ ,  $P < 0.001$ ) as  
178 well as the bacterial load of positives expressed as geometric mean ( $F = 26.007$ ,  $P < 0.001$ ).  
179 Monochloramine showed the lowest percentage of positives (9/95, 9.5%), followed by chlorine dioxide  
180 (60/201, 29.8%), hydrogen peroxide (80/208, 38.5%) and hyperthermia (36/66, 54.5%). Regarding  
181 *Legionella* concentrations, no differences in the geometric mean were observed according to chemical  
182 treatments ( $2.2 \times 10^2$  CFU liter<sup>-1</sup> for monochloramine,  $3.0 \times 10^2$  CFU liter<sup>-1</sup> for chlorine dioxide and  $1.3$   
183  $\times 10^2$  CFU liter<sup>-1</sup> for hydrogen peroxide), while a significantly higher geometric mean ( $1.7 \times 10^3$  CFU  
184 liter<sup>-1</sup>) was observed for the heat-treated positive samples than for the samples treated with all biocides  
185 (Bonferroni test,  $P < 0.05$ ).

186 Table 1 shows the number, percentage of positive samples and their geometric mean according to the  
187 biocide/temperature levels. No significant difference in the percentage of positives relating to the  
188 concentrations of monochloramine was observed and 3 mg liters<sup>-1</sup> are required in order to obtain  
189 legionellae  $< 10^2$  CFU liter<sup>-1</sup>. Levels of chlorine dioxide  $\geq 0.50$  mg litre<sup>-1</sup> significantly reduced the

190 percentage of positive points below 30% ( $\chi^2 = 3.930$ ,  $P < 0.05$ ). Hydrogen peroxide between 15 and  
191 19.9 mg liter<sup>-1</sup> was associated with a significant reduction in positive points ( $\chi^2 = 3.823$ ,  $P < 0.05$ ), yet  
192 levels  $\geq 20$  mg liter<sup>-1</sup> are required to obtain less than 30% of positive distal points. A significant  
193 reduction of positives was observed by increasing the temperature to 55 - 59.9°C ( $\chi^2 = 7.796$ ,  $P <$   
194 0.010) but no positive sample was observed when the temperature reached 60°C. For all treatments, the  
195 bacterial load did not differ according to the biocide/temperature levels and only a limited number of  
196 samples exceeded  $1.0 \times 10^4$  CFU liter<sup>-1</sup> (one with monochloramine and hyperthermia, two with chlorine  
197 dioxide).

198 Table 2 shows that waters treated with chlorine-based systems were mainly contaminated with *L.*  
199 *pneumophila* serogroup 1, hyperthermia was strictly associated with *L. pneumophila* serogroups 2-14  
200 and hydrogen peroxide was mainly associated with non-*pneumophila* species (54.5% *L.*  
201 *jamestowniensis*, 36.4% *L. anisa* and 9.1% both).

202 Among the 394 water samples whose cultures were negative, 88 were analysed with molecular  
203 methods (Table 3). Chemical biocides showed a similar percentage of positives by qPCR, but no  
204 positive sample by EMA-qPCR. Over 95% of the heat-treated samples were positive with qPCR and  
205 50% with EMA-qPCR. Positive EMA-qPCR analyses were also associated to samples at temperatures  
206 over 60°C (6/11, 54.5%).

207 The average loss of thickness of the coupons exposed to treated and untreated waters did not  
208 significantly differ according to the type of treatment and time of exposure. As a mean, the corrosion  
209 rate was  $0.17 \pm 0.03$  mm/year for the coupons exposed to hydrogen peroxide,  $0.15 \pm 0.03$  mm/year for  
210 hyperthermia,  $0.14 \pm 0.04$  mm/year for the untreated network,  $0.14 \pm 0.03$  mm/year for chlorine  
211 dioxide and  $0.11 \pm 0.05$  mm/year for monochloramine.

212 The morphology of corrosion did not change over time, but differed according to the treatment. As an  
213 example, the morphology of corrosion according to treatment following six months of water exposure

214 is reported in fig 2. The coupons exposed to chlorine dioxide presented a uniform corrosion with  
215 pitting and ulcerations (image A), those exposed to monochloramine showed a uniform corrosion as  
216 well as rare pitting (image B), and those exposed to hydrogen peroxide were characterized by pitting,  
217 whose size ranged from a few microns up to several millimetres (image C). Finally, coupons of the  
218 heat-treated waters (image D) showed a uniform corrosion with some ulcerations similarly to those  
219 observed on untreated samples (*image not shown*).

220

## 221 DISCUSSION

222 In this study, we followed the trend of contamination by *Legionella* spp in hospital hot water networks  
223 treated with different disinfection procedures. The effectiveness of these procedures was evaluated  
224 using the traditional culture, the qPCR and the EMA-qPCR in order to detect culturable and NC  
225 *Legionella* cells. Among the studied disinfection strategies, we included monochloramine, an  
226 innovative method which proved to be effective in controlling *Legionella* contamination in a hospital  
227 water network (22, 35). We also studied hydrogen peroxide which has not yet been extensively used for  
228 controlling *Legionella* in hospital water distribution systems (36, 37). A comparison was carried out  
229 between these new procedures and two popular methods such as chlorine dioxide and hyperthermia,  
230 which have been widely reported to be effective (38-42).

231 Our study confirms the effectiveness of continuous chemical disinfection, but we emphasize that all  
232 systems must be continuously monitored since none of them eradicates legionellae from water  
233 distribution systems (6, 36, 43). On comparing the three disinfectants, monochloramine proves to be  
234 the most effective approach, as it gave the best results in reducing the percentage of positive points by  
235 culture, followed by chlorine dioxide and hydrogen peroxide. Moreover, for all biocides approximately  
236 50% of the culture negative samples analysed using molecular methods was found positive by qPCR,  
237 but negative by EMA-qPCR. This confirms that the qPCR can give false positives when the biocides

238 are applied in a contaminated system as previously reported (17), and that a continuous injection of  
239 chemicals that are capable of killing the circulating microbes, avoids the induction of VBNC forms of  
240 legionellae.

241 On the contrary, the network treated with hyperthermia is more contaminated both in terms of  
242 percentage of positive sites and bacterial load. The Italian and European guidelines recommend  
243 maintaining the water temperature between 55 and 60°C constantly in order to prevent *Legionella*  
244 contamination (44, 45), yet in our study this range proved to be ineffective as over 60% of the samples  
245 remained positive. Interestingly, the presence of NC legionellae was also observed at temperatures  
246 around 60°C, which is considered to be a safe value for preventing *Legionella* contamination (46).  
247 Recent studies demonstrate that VBNC legionellae are again culturable upon resuscitation within  
248 amoebae and that infection can initiate following their resuscitation (14). In this respect, the NC cells  
249 generated following the thermal treatment used in our hospital could constitute a potential public health  
250 hazard. For all these reasons, we do not advise using hyperthermia as the only method for controlling  
251 *Legionella* contamination in hospital water networks.

252 We stress the importance of finding an adequate level of biocide for controlling *Legionella*  
253 contamination as our long-term experience suggests that the effectiveness of chlorine-based chemicals  
254 changes over time. After one year of disinfection applications, we proposed a level of chlorine dioxide  
255 between 0.30 - 0.40 mg liter<sup>-1</sup> and 2.0 mg liter<sup>-1</sup> of monochloramine to lower contamination below 10<sup>2</sup>  
256 CFU liter<sup>-1</sup> (35). In the following 3 years, the levels required for obtaining the same reduction were  
257 0.50 - 0.70 mg liter<sup>-1</sup> for chlorine dioxide, and 2 - 3 mg liter<sup>-1</sup> for monochloramine (22). In this study,  
258 chlorine dioxide ≥ 0.50 mg liter<sup>-1</sup> was associated with 10<sup>3</sup> CFU liter<sup>-1</sup> but the percentage of positives  
259 was below 30%, a value reported as being an indicator of low risk for disease transmission (47).  
260 Similarly, a monochloramine ≥ 3 mg liter<sup>-1</sup> was required to maintain *Legionella* below 10<sup>2</sup> CFU liter<sup>-1</sup>,  
261 in accordance with other authors (48-50), but the percentage of positive sites was less than 30%

262 independently of the biocide levels, thus confirming the satisfactory results obtained with this  
263 disinfectant.

264 Hydrogen peroxide only produced satisfactory results in reducing *Legionella* contamination when  
265 biocide was  $\geq 20$  mg liter<sup>-1</sup>, in agreement with other studies (36, 37). For this procedure, the high  
266 percentage of positive points, although at low levels, was due to the difficulty in regulating the  
267 disinfectant concentration, probably because the building was under renovation and many of the outlets  
268 were seldom used. Hydrogen peroxide appears to be a promising alternative for decreasing *Legionella*  
269 colonization; however, further field studies in other healthcare and community settings are required in  
270 order to confirm its effectiveness.

271 The chlorine-based biocides caused a shift from *L. pneumophila* serogroups 2-14 to *L. pneumophila*  
272 serogroup 1 while hydrogen peroxide favoured the switch from *L. pneumophila* to other species,  
273 mainly *L. jamestowniensis*, which has not yet been associated with human disease (51, 52).  
274 Contrastingly, no shift was observed with hyperthermia, which is in line with its ineffectiveness in  
275 reducing the *Legionella* colonization. The continuous injection of chlorine-based biocides evidently  
276 selects the most resistant *Legionella* spp, in our experience the *L. pneumophila* serogroup 1 which is  
277 also the most virulent (1). In order to support this hypothesis, other authors reported the persistence of  
278 serogroup 1 in hospital water systems despite the adoption of chlorine-based disinfection strategies  
279 (53, 54). Duda et al. (50) reported a shift from *L. pneumophila* serogroup 1 to *L. bozemanii*, which are  
280 both associated with human pathologies, following 24 months of monochloramine applications.

281 It is well known that disinfection can speed up corrosion and cause plumbing leaks, even if  
282 contradictory results are reported in literature concerning the impact of disinfection on corrosion (7-  
283 10). To complete the study, we studied the appearance of a favourable environment for corrosion within  
284 the water networks according to the disinfection methods applied. The loss of thickness of the carbon  
285 steel foils which were used to evaluate the extent of corrosion over a six-month period, does not exceed

286 the average values of 0.50 mm/year that are considered satisfactory for water networks (55), and no  
287 significant differences were observed between treated and untreated networks. On the other hand  
288 differences were observed regarding the morphology of corrosion. Hydrogen peroxide and chlorine  
289 dioxide caused pitting, which is a type of corrosion that can create holes in tubes (9). Monochloramine  
290 and hyperthermia appeared to be less aggressive, since monochloramine caused a uniform corrosion  
291 with rare formation of pitting, and hyperthermia showed a morphology of corrosion similar to that  
292 observed in the untreated coupons. The results encouraged us to continue the corrosion study therefore  
293 we are now analysing the long-term corrosive effect of these four disinfection procedures on commonly  
294 used plumbing materials such as copper, stainless steel, galvanized steel and polyvinyl chloride, the last  
295 two also used in our hospitals.

296

## 297 REFERENCES

- 298 1. **Rota MC, Caporali MG, Bella A, Ricci ML, Napoli C.** 2013. Legionnaires' disease in Italy:  
299 results of the epidemiological surveillance from 2000 to 2011. *Euro Surveill* **18(23):**20497.
- 300 2. **ECDC - European Centre for Disease Prevention and Control.** 2014. Legionnaires' disease  
301 in Europe 2012.
- 302 3. **ISS - Istituto Superiore di Sanità.** 2014. Rapporto annuale sulla legionellosi in Italia nel 2013.  
303 *Notiziario ISS* **27(10):**3-9.
- 304 4. **Ferranti G, Marchesi I, Favale M, Borella P, Bargellini A.** 2014. Etiology, source and  
305 prevention of waterborne healthcare-associated infections: a review. *J Med Microbiol* **63(Pt**  
306 **10):**1247-59.
- 307 5. **WHO - World Health Organization.** 2007. Legionella and the prevention of legionellosis.
- 308 6. **Lin YE, Stout JE, Yu VL.** 2011. Controlling *Legionella* in hospital drinking water: an  
309 evidence-based review of disinfection methods. *Infect Control Hosp Epidemiol* **32(2):**166-73.

- 310 7. **Eisnor, JD, Gagnon, GA.** 2004. Impact of secondary disinfection on corrosion in a model  
311 water distribution system. *J Water Supply Res Technol* **53(7)**:441–452.
- 312 8. **Chord F, Fascia P, Mallaval F, Cornillon J, Roesch L, Pozzetto B, Grattard F, Berthelot**  
313 **P.** 2011. Chlorine dioxide for *Legionella* spp. disinfection: a danger for cross-linked  
314 polyethylene pipes? *J Hosp Infect* **78(3)**:242-3.
- 315 9. **Castillo Montes J, Hamdani F, Creus J, Touzain S, Correc O.** 2014. Impact of chlorinated  
316 disinfection on copper corrosion in hot water systems. *App Surf Sci* **314**:686-696.
- 317 10. **Masters S, Wang H, Pruden A, Edwards MA.** 2015. Redox gradients in distribution systems  
318 influence water quality, corrosion, and microbial ecology. *Water Res* **68**:140-9.
- 319 11. **Ballard AL, Fry NK, Chan L, Surman SB, Lee JV, Harrison TG, Towner KJ.** 2000.  
320 Detection of *Legionella pneumophila* using a real-time PCR hybridization assay. *J Clin*  
321 *Microbiol* **38(11)**:4215-8.
- 322 12. **Wellinghausen N, Frost C, Marre R.** 2001. Detection of legionellae in hospital water samples  
323 by quantitative real-time LightCycler PCR. *Appl Environ Microbiol* **67(9)**:3985-93.
- 324 13. **Joly P, Falconnet PA, André J, Weill N, Reyrolle M, Vandenesch F, Maurin M, Etienne J,**  
325 **Jarraud S.** 2006. Quantitative real-time *Legionella* PCR for environmental water samples: data  
326 interpretation. *Appl Environ Microbiol* **72(4)**:2801-8.
- 327 14. **Epalle T, Girardot F, Allegra S, Maurice-Blanc C, Garraud O, Riffard S.** 2015. Viable but  
328 not culturable forms of *Legionella pneumophila* generated after heat shock treatment are  
329 infectious for macrophage-like and alveolar epithelial cells after resuscitation on *Acanthamoeba*  
330 *polyphaga*. *Microb Ecol* **69(1)**:215-24.
- 331 15. **Oliver JD.** 2010. Recent findings on the viable but nonculturable state in pathogenic bacteria.  
332 *FEMS Microbiol Rev* **34(4)**:415-25.

- 333 16. **Chen NT, Chang CW.** 2010. Rapid quantification of viable legionellae in water and biofilm  
334 using ethidium monoazide coupled with real-time quantitative PCR. *J Appl Microbiol*  
335 **109(2):**623-34.
- 336 17. **Delgado-Viscogliosi P, Solignac L, Delattre JM.** 2009. Viability PCR, a culture-independent  
337 method for rapid and selective quantification of viable *Legionella pneumophila* cells in  
338 environmental water samples. *Appl Environ Microbiol* **75(11):**3502-12.
- 339 18. **Cangelosi GA, Meschke JS.** 2014. Dead or alive: molecular assessment of microbial viability.  
340 *Appl Environ Microbiol* **80:**5884-5891
- 341 19. **Mansi A, Amori I, Marchesi I, Marcelloni AM, Proietto AR, Ferranti G, Magini V,**  
342 **Valeriani F, Borella P.** 2014. *Legionella* spp. survival after different disinfection procedures:  
343 Comparison between conventional culture, qPCR and EMA–qPCR. *Microchem J* **112:**65-69.
- 344 20. **Qin T, Tian Z, Ren H, Hu G, Zhou H, Lu J, Luo C, Liu Z, Shao Z.** 2012. Application of  
345 EMA-qPCR as a complementary tool for the detection and monitoring of *Legionella* in different  
346 water systems. *World J Microbiol Biotechnol* **28(5):**1881-90.
- 347 21. **Fittipaldi M, Codony F, Adrados B, Camper AK, Morató J.** 2011. Viable real-time PCR in  
348 environmental samples: can all data be interpreted directly? *Microb Ecol* **61(1):**7-12.
- 349 22. **Marchesi I, Ferranti G, Bargellini A, Marchegiano P, Predieri G, Stout JE, Borella P.**  
350 2013. Monochloramine and chlorine dioxide for controlling *Legionella pneumophila*  
351 contamination: biocide levels and disinfection by-product formation in hospital water networks.  
352 *J Water Health* **11(4):**738-47.
- 353 23. **Marchesi I, Marchegiano P, Bargellini A, Cencetti S, Frezza G, Miselli M, Borella P.** 2011.  
354 Effectiveness of different methods to control *Legionella* in the water supply: ten-year  
355 experience in an Italian university hospital. *J Hosp Infect* **77(1):**47-51.



- 356 24. **WHO - World Health Organization**. 2011. Guidelines for drinking-water quality - 4th ed.
- 357 25. **U.S. Environmental Protection Agency**. 2012. Drinking Water Standards and Health  
358 Advisories. EPA 822-S-12-001.
- 359 26. **Borella P, Montagna MT, Stampi S, Stancanelli G, Romano-Spica V, Triassi M, Marchesi  
360 I, Bargellini A, Tatò D, Napoli C, Zanetti F, Leoni E, Moro M, Scaltriti S, Ribera D'Alcalà  
361 G, Santarpia R, Boccia S**. 2005. *Legionella* contamination in hot water of Italian hotels. Appl  
362 Environ Microbiol **71(10)**:5805-13.
- 363 27. **ISO 11731:1998**. Water quality - Detection and enumeration of *Legionella*. Geneva,  
364 Switzerland.
- 365 28. **Bargellini A, Marchesi I, Leoni E, Mansi A, Cristino S, Marcelloni AM, Borella P**. 2010.  
366 Inter-laboratory validation of a rapid assay for the detection and quantification of *Legionella*  
367 spp. in water samples. Lett Appl Microbiol **51(4)**:421-7.
- 368 29. **Mansi A, Amori I, Marchesi I, Proietto AR, Marcelloni AM, Giugliano R, Ferranti G,  
369 Bargellini A, Borella P**. 2013. Abstr 8th International Conf. on Legionella, Melbourne,  
370 Australia, p 80.
- 371 30. **ISO/TS 12869:2012**. Water quality - Detection and quantification of *Legionella* spp. and/or  
372 *Legionella pneumophila* by concentration and genic amplification by quantitative polymerase  
373 chain reaction (qPCR). Geneva, Switzerland.
- 374 31. **Omiccioli E, Schiavano GF, Ceppetelli V, Amagliani G, Magnani M, Brandi G**. 2015.  
375 Validation according to ISO/TS 12869:2012 of a molecular method for the isolation and  
376 quantification of *Legionella* spp. in water. Mol Cell Probes **29(2)**:86-91.
- 377 32. **ASTM G1-03:2011**. Standard Practice for Preparing, Cleaning, and Evaluating Corrosion Test  
378 Specimens. Book of Standards Volume: 03.02. PA, USA.

- 379 33. **ASTM G4-01:2014**. Standard Guide for Conducting Corrosion Tests in Field Applications.  
380 Book of Standards Volume: 03.02. PA, USA.
- 381 34. **UNI EN 10224:2006**. Non-alloy steel tubes and fittings for the conveyance of aqueous liquids  
382 including water for human consumption - technical delivery conditions.
- 383 35. **Marchesi I, Cencetti S, Marchegiano P, Frezza G, Borella P, Bargellini A**. 2012. Control of  
384 *Legionella* contamination in a hospital water distribution system by monochloramine. Am J  
385 Infect Control **40(3)**:279-81.
- 386 36. **Shuval H, Yarom R, Shenman R**. 2009. An Innovative Method for the Control of *Legionella*  
387 Infections in the Hospital Hot Water Systems with a Stabilized Hydrogen Peroxide-Silver  
388 Formulation. Int J Infect Control **5**:1.
- 389 37. **Cristino S, Legnani PP, Leoni E**. 2012. Plan for the control of *Legionella* infections in long-  
390 term care facilities: role of environmental monitoring. Int J Hyg Environ Health **215(3)**:279-85.
- 391 38. **Darelid J, Löfgren S, Malmvall BE**. 2002. Control of nosocomial Legionnaires' disease by  
392 keeping the circulating hot water temperature above 55 degrees C: experience from a 10-year  
393 surveillance programme in a district general hospital. J Hosp Infect **50(3)**:213-9.
- 394 39. **Srinivasan A, Bova G, Ross T, Mackie K, Paquette N, Merz W, Perl TM**. 2003. A 17-  
395 month evaluation of a chlorine dioxide water treatment system to control *Legionella* species in a  
396 hospital water supply. Infect Control Hosp Epidemiol **24(8)**:575-9.
- 397 40. **Sidari FP III, Stout JE, VanBriesen JM, Bowman AM, Grubb D, Neuner A, Wagener**  
398 **MM, Yu VL**. 2004. Keeping *Legionella* out of water systems. J Am Water Works Assoc  
399 **96**:111-119.

- 400 41. **Blanc DS, Carrara P, Zanetti G, Francioli P.** 2005. Water disinfection with ozone, copper  
401 and silver ions, and temperature increase to control *Legionella*: seven years of experience in a  
402 university teaching hospital. *J Hosp Infect* **60(1):69-72.**
- 403 42. **Tesauro M, Bianchi A, Consonni M, Pregliasco F, Galli MG.** 2010. Environmental  
404 surveillance of *Legionella pneumophila* in two Italian hospitals. *Ann Ist Super Sanita*  
405 **46(3):274-8.**
- 406 43. **Casini B, Buzzigoli A, Cristina ML, Spagnolo AM, Del Giudice P, Brusaferrero S, Poscia A,**  
407 **Moscato U, Valentini P, Baggiani A, Privitera G.** 2014. Long-term effects of hospital water  
408 network disinfection on *Legionella* and other waterborne bacteria in an Italian university  
409 hospital. *Infect Control Hosp Epidemiol* **35(3):293-9.**
- 410 44. **ISS - Istituto Superiore di Sanità.** 2000. Linee Guida italiane per la prevenzione e il controllo  
411 della legionellosi. *Gazzetta Ufficiale della Repubblica Italiana Serie Generale n.103 del 05-05-*  
412 *2000.*
- 413 45. **EWGLI - European Working Group for Legionella Infections.** 2011. Technical Guidelines  
414 for the investigation, control and prevention of travel associated Legionnaires' disease. Version  
415 1.1.
- 416 46. **Kim BR, Anderson JE, Mueller SA, Gaines WA, Kendall AM.** 2002. Efficacy of various  
417 disinfectants against *Legionella* in water systems. *Water Res* **36(18):4433-44.**
- 418 47. **ACHD - Allegheny County Health Department.** 1997. Approaches to the prevention and  
419 control of *Legionella* infection in Allegheny County health care facilities.
- 420 48. **Chien SH, Chowdhury I, Hsieh MK, Li H, Dzombak DA, Vidic RD.** 2012. Control of  
421 biological growth in recirculating cooling systems using treated secondary effluent as makeup  
422 water with monochloramine. *Water Res* **46(19):6508-18.**

- 423 49. **Kandiah S, Yassin MH, Stout J.** 2013. Monochloramine use for prevention of *Legionella* in  
424 hospital water systems. *Infect Disord Drug Targets* **13(3)**:184-90.
- 425 50. **Duda S, Kandiah S, Stout JE, Baron JL, Yassin M, Fabrizio M, Ferrelli J, Hariri R,**  
426 **Wagener MM, Goepfert J, Bond J, Hannigan J, Rogers D.** 2014. Evaluation of a new  
427 monochloramine generation system for controlling *Legionella* in building hot water systems.  
428 *Infect Control Hosp Epidemiol* **35(11)**:1356-63.
- 429 51. **Brenner DJ, Steigerwalt AG, Gorman GW, Wilkinson HW, Bibb WF, Hackel M, Tyndall**  
430 **RL, Campbell J, Feeley JC, Thacker WL, Skaliy P, Martin WT, Brake BJ, Fields BS,**  
431 **McEachern HV and Corcoran LK.** 1985. Ten New Species of *Legionella*. *IJSEM* 50-59.
- 432 52. **Casati S, Conza L, Bruin J, Gaia V.** 2010. Compost facilities as a reservoir of *Legionella*  
433 *pneumophila* and other *Legionella* species. *Clin Microbiol Infect* **16(7)**:945-7.
- 434 53. **Scaturro M, Dell'eva I, Helfer F, Ricci ML.** 2007. Persistence of the same strain  
435 of *Legionella pneumophila* in the water system of an Italian hospital for 15 years. *Infect Control*  
436 *Hosp Epidemiol* **28(9)**:1089-92.
- 437 54. **Casini B, Valentini P, Baggiani A, Torracca F, Frateschi S, Nelli LC, Privitera G.** 2008.  
438 Molecular epidemiology of *Legionella pneumophila* serogroup 1 isolates following long-term  
439 chlorine dioxide treatment in a university hospital water system. *J Hosp Infect* **69(2)**:141-7.
- 440 55. **Campbell FC.** 2012. *Fatigue and Fracture: Understanding the Basics.* ASM International  
441 Publisher, OH, USA.
- 442

443 Table 1. Number, percentage of positive samples and their geometric mean by culture according to the  
 444 biocide/temperature levels.

	positive n. (%)	geom. mean of positives (range) CFU liter <sup>-1</sup>
<b>Monochloramine</b>		
<2.0 mg liter <sup>-1</sup>	2/8 (25.0)	2.0 x 10 <sup>3</sup> (1.2 x 10 <sup>2</sup> – 3.1 x 10 <sup>4</sup> )
2.0 – 2.9 mg liter <sup>-1</sup>	4/29 (13.8)	3.7 x 10 <sup>2</sup> (25 – 5.7 x 10 <sup>3</sup> )
≥3.0 mg liter <sup>-1</sup>	3/58 (5.2)	25 (25)
	$\chi^2=4.131$ , ns	F=1.963, ns
<b>Chlorine dioxide</b>		
<0.30 mg liter <sup>-1</sup>	31/84 (36.9)	4.0 x 10 <sup>2</sup> (25 – 2.5 x 10 <sup>4</sup> )
0.30-0.49 mg liter <sup>-1</sup>	18/54 (33.3)	3.5 x 10 <sup>2</sup> (25 – 4.1 x 10 <sup>4</sup> )
≥0.50 mg liter <sup>-1</sup>	11/63 (17.5)	1.0 x 10 <sup>2</sup> (25 – 5.5 x 10 <sup>3</sup> )
	$\chi^2=6.928$ , $P < 0.05$	F=2.058, ns
<b>Hydrogen peroxide</b>		
<15.0 mg liter <sup>-1</sup>	46/91 (50.5)	1.1 x 10 <sup>2</sup> (25 – 1.4 x 10 <sup>3</sup> )
15-19.9 mg liter <sup>-1</sup>	14/43 (32.6)	2.6 x 10 <sup>2</sup> (25 – 5.0 x 10 <sup>3</sup> )
≥20.0 mg liter <sup>-1</sup>	20/74 (27.0)	1.1 x 10 <sup>2</sup> (25 – 2.3 x 10 <sup>3</sup> )
	$\chi^2=10.339$ , $P < 0.001$	F=2.468, ns
<b>Hyperthermia</b>		
50-54.9°C	19/21 (90.5)	2.5 x 10 <sup>3</sup> (25 – 1.2 x 10 <sup>4</sup> )
55-59.9°C	17/27 (63.0)	1.2 x 10 <sup>3</sup> (25 – 7.9 x 10 <sup>3</sup> )
≥60°C	0/18 (0)	-
	$\chi^2=33.31$ , $P < 0.001$	F=0.481, ns

445

446

447 Table 2. Number and percentage of species and serogroups of *Legionella* according to the treatments  
 448 ( $\chi^2=270.042$ ,  $P < 0.001$ ).

	<i>L. pneumophila</i> sg 1 alone or with others	<i>L. pneumophila</i> 2-14	<i>L. spp</i>
<b>monochloramine</b>	7 (77.8)	0 (0.0)	2 (22.2)
<b>chlorine dioxide</b>	51 (85.0)	4 (6.7)	5 (8.3)
<b>hydrogen peroxide</b>	21 (26.3)	5 (6.2)	54 (67.5)
<b>hyperthermia</b>	0 (0.0)	36 (100.0)	0 (0.0)

449

450

451 Table 3. Molecular analysis of culture negative samples.

	n (%) positive	
	qPCR	EMA-qPCR
<b>monochloramine</b>	11/22 (50.0)	0/22 (0.0)
<b>chlorine dioxide</b>	9/22 (40.9)	0/22 (0.0)
<b>hydrogen peroxide</b>	10/22 (45.4)	0/22 (0.0)
<b>hyperthermia</b>	21/22 (95.4)	11/22 (50.0)
	$\chi^2=15.246$ , $P < 0.005$	$\chi^2=27.957$ , $P < 0.001$

452

453




454

455 Fig. 1. Picture of rack used in order to support coupons for the test of corrosion.

456

457 Fig. 2. Digitalized images of one of the two coupons removed after 6 months of water exposure for  
458 each treatment (3x magnification).

459

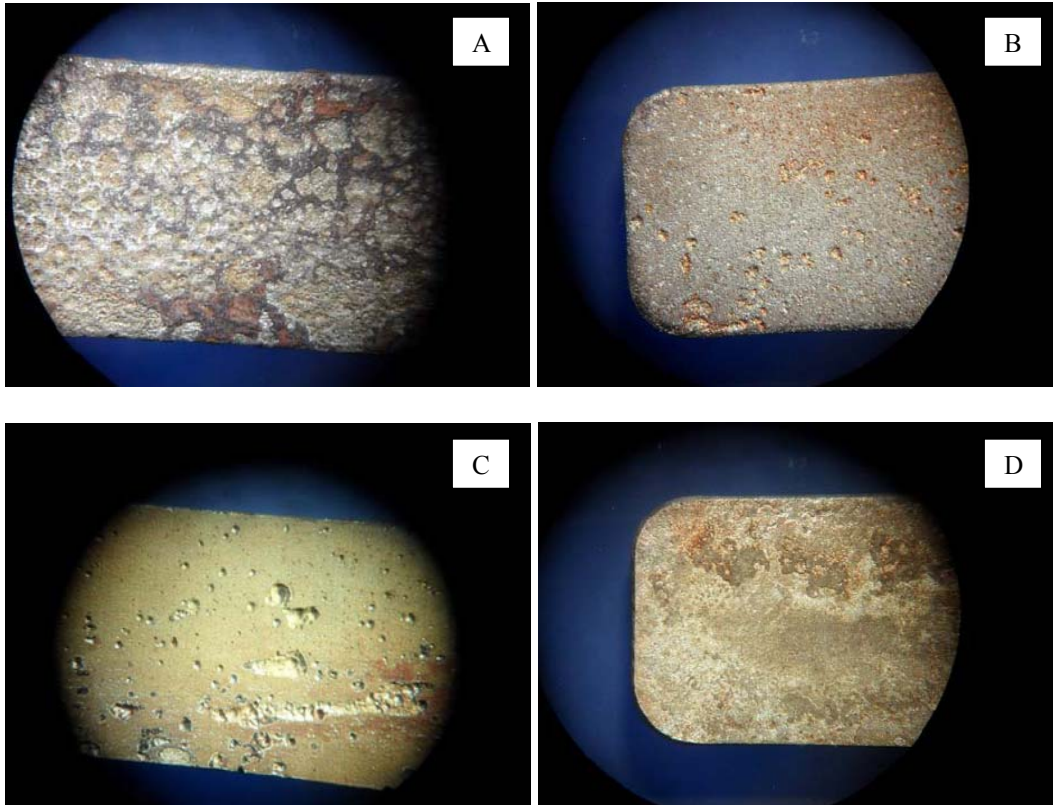

461

462 Legend

463 A = coupons treated with chlorine dioxide

464 B = coupons treated with monochloramine

465 C = coupons treated with hydrogen peroxide

466 D = coupons treated with hyperthermia (similar to untreated carbon steel coupons, not shown)

467