

This is the peer reviewed version of the following article:

Impregnated Carbon Fabric-Reinforced Cementitious Matrix Composite for Rehabilitation of the Finale Emilia Hospital Roofs: Case Study / Nobili, Andrea; Falope, FEDERICO OYEDEJI. - In: JOURNAL OF COMPOSITES FOR CONSTRUCTION. - ISSN 1090-0268. - STAMPA. - 21:4(2017), pp. 05017001-05017022. [10.1061/(ASCE)CC.1943-5614.0000780]

Terms of use:

The terms and conditions for the reuse of this version of the manuscript are specified in the publishing policy. For all terms of use and more information see the publisher's website.

18/04/2024 17:18

(Article begins on next page)

1 **IMPREGNATED CARBON FABRIC REINFORCED**
2 **CEMENTITIOUS MATRIX COMPOSITE FOR**
3 **REHABILITATION OF THE FINALE EMILIA HOSPITAL**
4 **ROOFS: A CASE STUDY**

5 Andrea Nobili, Ph.D., P.E.¹ and Federico O. Falope, P.E.²

6 **ABSTRACT**

7 In this paper, the mechanical performance of concrete beams strengthened by an impreg-
8 nated Carbon Fabric Reinforced Cementitious Matrix (CFRCM) composite is investigated.
9 The study is aimed at the rehabilitation of the Finale Emilia hospital roofs, severely damaged
10 by the 2012 Northern Italy earthquake. A 8-m-long concrete beam could be taken from the
11 building for reinforcement and testing in a beam test setup. The composite is designed to be
12 externally applied to the existing thin clay tile layer bonded to the concrete beam intrados.
13 Two lamination cycles are considered, which differ in the way the partially-organic adhesion
14 promoter is applied to the fabric. It is found that impregnation thorough fabric immersion
15 provides a 1.5-fold increase in the ultimate strength of the strengthened beam compared
16 to expedited impregnation with a brush. Besides, clay tiles make a very good supporting
17 substrate, to the extent that cohesive fracture at the tile/concrete interface takes place on
18 the verge of concrete failure near the hinge zone. Conversely, expedited impregnation of
19 the carbon fabric with the adhesion promoter is unable to provide adequate fabric/matrix
20 adhesion and leads to delamination failure. Estimates of the adhesion strength, of the opti-
21 mal bonded length and of the composite as well as of the concrete strain at failure are also
22 provided.

¹Dipartimento di Ingegneria Enzo Ferrari, Università degli Studi di Modena e Reggio Emilia, via Vignolese 905, 41125 Modena, Italy. (Corresponding author) E-mail:andrea.nobili@unimore.it

²Dipartimento di Ingegneria Enzo Ferrari, Università degli Studi di Modena e Reggio Emilia, via Vignolese 905, 41125 Modena, Italy. E-mail:federicooyedeji.falope@unimore.it

23 **Keywords:** Fabric reinforced Cementitious Material, Structural Rehabilitation, Clay tile,
24 Roof beam strengthening

25 INTRODUCTION

26 Reinforcement and rehabilitation of structurally deficient structures sets a difficult engi-
27 neering challenge. Historically, jacketing with new concrete bond with surface adhesive or
28 epoxy bonded steel plates have long been the preferred options to retrofit flexural members
29 (Blanksvärd and Täljsten 2008). In more recent times, a number of different technologies
30 have been made available, ranging from glass fiber reinforced polymer (GFRP) composite
31 plates (Saadatmanesh and Ehsani 1991; Rahimi and Hutchinson 2001), carbon fiber rein-
32 forced polymer (CFRP) composites (Norris et al. 1997; Mouring et al. 2001), high strength
33 composites (Ombres 2011a; Arboleda 2014). In particular, great attention has been re-
34 cently drawn towards brittle inorganic cement-based matrix composites, as opposed to duc-
35 tile polymeric-based ones, in light of some limitations of the organic binder (Bentur and
36 Mindess 2006; Toutanji and Deng 2007). The inorganic matrix may accommodate different
37 kinds of reinforcement, either in the shape of long fibers arranged in sheets or nets (fabric re-
38 inforced cementitious matrix, FRCM, or textile reinforced concrete, TRC), such as polypara-
39 phenylene benzobi-soxazole (PBO) (Ombres 2011b), glass or carbon fabric (Babaeidarabad
40 et al. 2014) or randomly dispersed short fibers, such as polypropylene (Lanzoni et al. 2012;
41 Nobili et al. 2013). Besides, reinforcement may be dry, in direct contact with the matrix,
42 or impregnated through some adhesion promoter, which enhances the bond with the binder
43 and hinders slippage.

44 In this paper, a Carbon Fabric Reinforced Cementitious Matrix (CFRCM) composite
45 is designed and tested for the rehabilitation of the concrete-joist-and-hollow-block roofs of
46 the “Ospedale Civile degli Infermi” (ICC-Evaluation Service 2013). This is a four-building
47 hospital facility located in Finale Emilia, which had been severely damaged by the 2012
48 Northern Italy earthquake (Tertulliani et al. 2012). The main hospital building (coded H1)
49 is a masonry unit which grew out of the former Santo Spirito church, whose conception dates

50 back to 1668. Although several literature contributions exist dealing with strengthening of
51 reinforced concrete (RC) beams by an externally applied FRCC composite (Triantafillou
52 and Papanicolaou 2005; Brückner et al. 2006; Al-Salloum et al. 2012; Loreto et al. 2013),
53 this paper investigates some novel and distinctive features. First, performance is assessed
54 in a beam test on roof beams taken from a case study application. Second, roof beams had
55 been cast onto a thin layer of clay tiles to provide material continuity with the hollow blocks
56 and an uniform substrate for plaster adhesion. Assessing the composite/tile/concrete bond
57 strength is crucial to developing a reliable reinforcement system directly applied onto the tile
58 surface. Indeed, mechanical removal of the tile layer prior strengthening is extremely costly
59 and time consuming, in light of the large area to be treated and of the extensive damage
60 this would cause to the underlying concrete. Besides, the clay tile provides a rough surface
61 suitable for direct lamination. Third, fabric is impregnated by a partially-organic adhesion
62 promoter and the extent of this impregnation deeply affects performance.

63 **EXPERIMENTAL PROGRAM**

64 **Application of the CFRCC composite**

65 A preliminary analysis of the main building found more than ten different types of roofs,
66 for the largest part constituted by concrete beams with hollow blocks in between, with
67 different slab thickness and orientation (Fig.1). A roof typical cross-section is shown in
68 Fig.2. An impregnated CFRCC composite is considered to be bonded at the intrados of
69 the concrete beams taken from the Finale Emilia hospital roof. The composite material is
70 applied according to the following steps:

- 71 1. the substrate (i.e. the clay tile) is wetted and then a water-based liquid inorganic
72 adhesion promoter is applied with a brush;
- 73 2. a first mortar bed, roughly 5 mm thick, is laid;
- 74 3. cut-to-size pairs of uni-directional carbon fabric reinforcement sheets are impregnated
75 by the adhesion promoter through immersion and then squeezed out to eliminate the

76 excess of impregnating agent (only for Cycle A, see Fig.3);

77 4. a first sheet of uni-directional carbon fabric reinforcement is placed onto the mortar
78 bed and then rolled to dispense with trapped air bubbles (Fig.4);

79 5. a second sheet of the same uni-directional carbon fabric reinforcement is placed and
80 then rolled;

81 6. a second and final mortar bed, roughly 5 mm thick, is laid on top.

82 Alongside this treatment, which is termed Cycle A, a simpler process is considered, named
83 Cycle B, which dispenses with step 3. According to this simpler application cycle, the liquid
84 impregnation agent is applied with a brush directly to the carbon fabric already placed on
85 the mortar bed, both after steps 4 and 5 (Fig.3). The reason for this second option is that the
86 expected performance decay could be weighted against the advantage of a more expedited
87 process and the lower cost it conveys. All materials adopted in the analysis are commercially
88 available and their main properties are gathered in Table 1 for the mortar and in Table 2
89 for the fabric. The mortar (coded B) and the impregnation agent are characterized as single
90 components in Nobili (2016). The main reason for adopting this fairly low-strength mortar is
91 compatibility with the clay tile mechanical properties. Besides, this mortar, in conjunction
92 with the adopted adhesion promoter, has proved very effective in developing a strong bond
93 with the carbon fabric.

94 **Experimental setup**

95 In order to avoid weakening an already poorly performing structure, only a single 8-m-
96 long beam could be taken from the hospital roof (the original location of this beam is shown
97 in Fig.1). For transportation convenience, the beam was cut into 5 pieces, between 1.2 to
98 1.4 m long. The roof beam is fitted with a variable-along-the-length longitudinal steel bar
99 reinforcement, which roughly follows the bending moment diagram. Rebar surface is not
100 patterned. The mid-span longitudinal reinforcement is given by $3\varnothing 16 + 2\varnothing 6$ mm and by
101 $1\varnothing 16$ mm, respectively for lower and upper section reinforcement (see Fig.5). Conversely, the

102 beam end longitudinal reinforcement features 1∅6 mm (lower) and 1∅12 mm (upper section).
103 Table 3 gathers the cross-section inertial properties. It should be emphasized that the
104 longitudinal rebar distribution is incompatible with modern seismic design, for no provision
105 is taken against bending moment sign inversion. The beam pieces were further cut into a
106 total of 15 400-mm-long portions, each endowed with a different amount of longitudinal steel
107 rebars according to its location in the original joist. Transverse reinforcement is very weak
108 and only 1∅6/500 mm steel bar could be detected through pachometer testing. According
109 to the Italian Building Code (2008, §4.1.2.1.3.2), the theoretical ultimate shear strength
110 amounts to

$$111 \quad V_{Rcd} = 22.4 \text{ kN.} \quad (1)$$

112 In view of the high danger of brittle failure due to shear in a plain bending test, a beam
113 test (alias traction-through-bending test) on pairs of beam portions joined together through
114 a steel hinge was adopted (RILEM 1994). The test schematic is presented in Fig.6.

115 The joist pairs are joined together via removable mechanical connectors and then lami-
116 nated according to either Cycle A or B. After 28-day curing, they are tested in a four-point
117 bending test arrangement, through a Metro Com Engineering 7170S02 machine. On the
118 overall, 7 joist pairs could be tested, 3 laminated according to Cycle A and 4 to Cycle B. A
119 Q-400 Dantec Dynamics Digital Imaging Correlation (DIC) system was adopted to monitor
120 the displacement field of the beam tests (Becker et al.). The beam concrete properties were
121 determined through crash testing of drilled concrete cores. Indirect measurement through
122 concrete hammer testing (PCE-HT-225A) was also pursued but it provided scattered results
123 around an unrealistically high mean. Finally, a qualitative indication of concrete carbonation
124 was obtained through phenolphthalein titration.

125 **EXPERIMENTAL RESULTS**

Beam tests

Seven joist pairs, labeled from A1 to A7, were tested in a beam test through a four-point-bending machine equipped with a 200 kN load cell. No provision was taken against shear failure on the grounds that laminate debonding was expected to take place prior to shear failure (the latter taking place much before bending failure). According to CNR DT200 2004, §4.1.1, the optimal bonded length, l_e , beyond which no increase of the load transferred by the composite may be obtained, can be estimated as

$$l_e = \max \left(\frac{1}{\gamma_{Rd} f_{bd}} \sqrt{\frac{\pi^2 E_f t_f \Gamma_{fd}}{2}}, 200 \text{ mm} \right) = 245 \text{ mm} \quad (2)$$

where Γ_{fd} is the specific fracture energy which depends on the ultimate slip s_u (see also D'Ambrisi et al. 2013 for a suitable choice of s_u for FRCM materials) and parameters are given in Table 4. Clearly, for maximum performance, the bonded length l_b should exceed l_e . Indeed, a bonded length $l_b = 300$ mm was considered with no special anchoring device (e.g. U-wrapped fabric, transverse bars, abrasive blasting of the substrate surface etc.). The bending test was carried out under displacement control at 1 mm/min knife speed. Fig.7 gathers the results of the beam test while Fig.8 presents the failure mechanism for each specimen. Failure in specimens A1–A3, treated according to Cycle A, is either due to cohesive fracture in the thin tile layer, also known as intermediate debonding, or to tensile failure in the concrete (for a brief description of the different fracture mechanisms see CNR DT200 (2004)). Indeed, specimen A2 displayed clear evidence of tensile failure in the concrete near the hinge, which was accompanied by mixed cohesive fracture at the laminate interface.

Conversely, delamination of the fabric with fracture taking place at the fabric/matrix interface is always met in specimens A4–A7, prepared according to Cycle B. The difference in the failure mechanism reflects itself in a sharp difference among the ultimate loads, which exceed 60 kN for Cycle A as opposed to well below 50 kN for Cycle B. It is observed that

151 ultimate loads within Cycle A were remarkably consistent (cfr. error bar in Fig.10).

152 **Image Correlation results**

153 A Q400 Dantec Dynamics Digital Image Correlation system was employed to acquire
154 the displacement field along the beam test through application to the specimen side of a
155 fine coarse speckle array. A preliminary zero-displacement data acquisition allowed assessing
156 a 20 μm displacement background noise level (resolution). A technical problem prevented
157 recording displacement data of the A6 specimen. Two reference lines, named L and R
158 for the left and right element, respectively, are drawn symmetrically about the hinge. The
159 deformation of such lines (i.e. longitudinal displacement with respect to the original position)
160 is displayed in Fig.9 for specimen A2 at 60% of the ultimate load and just prior to failure.
161 The symmetry of the left-right line displacement is remarkable and holds for all specimens.

162 **Compression test of concrete cores**

163 After bending, four concrete cores were drilled in the joist longitudinal direction out of
164 two joist pairs. Owing to the cross-sectional shape, cores were 50 mm in diameter and about
165 100 mm in height. After drilling, core specimens were regularized. Uni-axial compression
166 tests were performed through a Metro Com Engineering E7072C300 machine, equipped with
167 a 3000 kN load cell, under force control, at a loading rate of 0.5 MPa/s. Compressive strength
168 results are recorded in Table 5, together with their adjusted value, according to Kim and Eo
169 (1990) and Benjamin and Cornell (1970), to compensate for the non-standard specimen size.
170 Maximum aggregate size is about 15 mm. On the overall, results showed good consistency,
171 with a relative standard deviation (alias coefficient of variation, CV) of about 12%. A lon-
172 gitudinal crack pattern consistently developed at failure, which agrees well with an uni-axial
173 compression failure mode (Neville and Brooks 1987). Indirect concrete hammer testing pro-
174 duced scattered and unrealistically over-estimated results. Finally, phenolphthalein titration
175 provided little evidence of carbonation, as expected for a indoor structural element.

176 **DISCUSSION**

Theoretical flexural strength

The ultimate theoretical flexural strength of the unreinforced cross-section at mid-span is, in the stress block approximation (Italian Building Code 2008, §4.1.2.1.2), $M_{Rd,midspan} = 32.2$ kNm which, compared with the shear strength (1), shows that a plain bending test would have been possible for a very long specimen, such that $l_A \geq 2.87 \text{ m} + l_F$. A similar calculation shows that the beam end section unreinforced strength amounts to $M_{Rd,ends} = 20.5$ kNm and, in a doubly built-in configuration, flexural failure still occurs at midspan. In this respect, the existing longitudinal reinforcement provides adequate flexural strength and the composite adds a comparatively small contribution to it. However, when considering bending moment sign inversion, the beam end section appears exceedingly weak at the intrados, with an ultimate theoretical strength of the unreinforced section of 12.6 kNm. Application of the composite reinforcement leads to a theoretical strength of 21.9 kNm for the end section, which warrants almost uniform flexural resistance for the beam in the case of bending moment sign inversion.

Adhesion and laminate strength

The beam test setup easily lead to the evaluation of the ultimate load for the composite as

$$N_u = \frac{M_u}{d}, \quad (3)$$

where $M_u = P(l_A - l_F)/4$ is the ultimate bending moment (Fig.6), $d = 210$ mm the lever arm and N_u the ultimate normal force conveyed through the hinge and the laminate. Once the normal force N_u is determined, the ultimate average shear stress easily follows

$$\tau_{av} = \frac{N_u}{A_b}, \quad (4)$$

where $A_b = b_4 l_b = 39000 \text{ mm}^2$ is the bonded area and l_b the bonded length.

The computed average shear stress, τ_{av} , for the specimens treated according to Cycle A is compatible with a clay tile failure mechanism and it is an important parameter to

202 design the roof reinforcement. Besides, evaluating the steel hinge net contact area with the
203 cross-section, $A_h = 8450 \text{ mm}^2$, the average compressive stress $\sigma = N/A_h \approx -4.09 \text{ MPa}$
204 and the corresponding tensile stress (through Mohr's circle) $\sigma/2 \approx 2.04 \text{ MPa}$, are easily
205 determined. In particular, the tensile stress far exceeds the ultimate tensile strength of
206 concrete $f_{ctm} \sim 0.46 \text{ MPa}$, as evaluated according to Italian Building Code (2008, §11.2.10.2),
207 which fact may help explain heavy concrete damage incurred at failure for specimens A1, A3
208 and especially A2. Delamination at the fabric/matrix interface appears to be determined by
209 ineffective impregnation of the fabric reinforcement by the adhesion promoter in Cycle B. In
210 fact, all specimens treated according to Cycle B fail to provide consistent levels of ultimate
211 strength in the beam test.

212 **Deformation at failure**

213 The digitally acquired displacement field provides a discrete approximation of the strain
214 field both in the concrete and, with lower accuracy, in the composite. The mean concrete
215 compressive strain at failure (near the hinge) for specimens A1–A3 is 1.24‰ with $CV =$
216 0.25‰, while the corresponding (tensile) mean strain in the composite is 1.04‰ with $CV =$
217 0.75%. It is interesting to observe that, introducing the concrete mean compressive strain
218 as the limiting deformation at failure in a stress block model, the theoretical strength of
219 the cross-section in a beam test, i.e. omitting the lower section rebars and assuming perfect
220 composite/substrate adhesion, amounts to 8.7 kNm (almost irrespectively whether it is mid-
221 span or end section), which is 16% greater than the average ultimate bending moment, M_u ,
222 as measured for specimens A1–A3 (see Table 6). However, the corresponding ultimate force
223 in the composite is 34.5 kNm, which differ very little (+1.4%) from the mean experimental
224 value. Finally, we note that the tensile mean strain in the composite at failure is very close
225 to the composite ultimate strain, ϵ_{fu} , which, according to ICC-Evaluation Service (2013), is
226 0.94‰ with $CV = 0.19\%$.

227 **CONCLUSIONS**

228 In this paper, the mechanical performance of an impregnated Carbon Fabric Reinforced

229 Cementitious Matrix (CFRCM) composite is considered. The composite is intended to
230 strengthen the RC roof beams of the Finale Emilia hospital, severely damaged by the 2012
231 Northern Italy earthquake. The following conclusions can be drawn from the foregoing
232 analysis:

- 233 • A beam test, in the absence of anchoring devices, was found effective in assessing
234 the composite strength, despite the variability of the longitudinal and the deficiency
235 of the traversal steel bar reinforcement and despite the surprisingly poor mechanical
236 performance of the concrete.
- 237 • External application of the composite to the thin clay tile layer onto which beams
238 had been originally cast is safe and economic: cohesive fracture at the tile/concrete
239 interface takes place at failure on the verge of brittle compressive failure in the con-
240 crete.
- 241 • Deformation data obtained from Digital Image Correlation give a tensile mean strain
242 in the composite at failure around 1.04%, which is very close to the design strain, while
243 the mean compressive strain in the concrete (near the hinge) is 1.24‰, which is lower
244 than expected (given that delamination occurs on the verge of concrete failure).
- 245 • Impregnation of the fabric needs be carefully considered. Indeed, impregnation through
246 immersion provides a 1.5-fold increase of the ultimate strength with respect to expe-
247 dited impregnation. Furthermore, lack of adhesion due to insufficient impregnation
248 consistently leads to fabric slippage in the matrix and, finally, debonding.
- 249 • Estimates of the composite strength, of the average shear strength at the compos-
250 ite/tile interface and of the optimal bonded length are given.
- 251 • Although the existing beam longitudinal steel bar reinforcement is adequate in a static
252 analysis, composite strengthening at the intrados is required when considering seismic
253 design and the possibility of bending moment sign inversion.

254 **ACKNOWLEDGMENTS**

255 This study was conducted in collaboration with Ardea Progetti e Sistemi Srl, Bologna,
256 Italy, and with Studio Melegari, Parma, Italy. Financial support from the Fondazione Cassa
257 di Risparmio di Modena, Pratica Sime nr.2013.0662, is gratefully acknowledged.

258 REFERENCES

- 259 Al-Salloum, Y. A., Elsanadedy, H. M., Alsayed, S. H., and Iqbal, R. A. (2012). “Experimental
260 and numerical study for the shear strengthening of reinforced concrete beams using textile-
261 reinforced mortar.” *Journal of Composites for Construction*, 16(1), 74–90.
- 262 Arboleda, D. (2014). “Fabric reinforced cementitious matrix (FRCM) composites for in-
263 frastructure strengthening and rehabilitation: Characterization methods.” Ph.D. thesis,
264 University of Miami, University of Miami. Open Access Dissertation. Paper 1282.
- 265 Babaeidarabad, S., Loreto, G., and Nanni, A. (2014). “Flexural strengthening of RC beams
266 with an externally bonded fabric-reinforced cementitious matrix.” *Journal of Composites
267 for Construction*, 18(5), 04014009.
- 268 Becker, T., Splitthof, K., Siebert, T., and Kletting, P. *Digital 3D-Correlation System Q-400*.
269 Dantec Dynamics. <http://www.dantecdynamics.com>.
- 270 Benjamin, J. and Cornell, C. (1970). *Probability, Statistics, and Decision for Civil Engineers*.
271 McGraw-Hill Publishing Company.
- 272 Bentur, A. and Mindess, S. (2006). *Fibre reinforced cementitious composites*. CRC Press.
- 273 Blanksvärd, T. and Täljsten, B. (2008). “Strengthening of concrete structures with cement
274 based bonded composites.” *Journal of Nordic Concrete Research*, 38, 133–153.
- 275 Brückner, A., Ortlepp, R., and Curbach, M. (2006). “Textile reinforced concrete for strength-
276 ening in bending and shear.” *Materials and structures*, 39(8), 741–748.
- 277 CNR DT200 (2004). “Guide for the design and construction of an externally bonded FRP
278 system for strengthening existing structures.” *Italian National Research Council, Rome
279 R1/2013*.
- 280 D’Ambrisi, A., Feo, L., and Focacci, F. (2013). “Experimental and analytical investigation

281 on bond between carbon-frcm materials and masonry.” *Composites Part B: Engineering*,
282 46, 15–20.

283 ICC-Evaluation Service (2013). “Acceptance criteria for masonry and concrete strengthening
284 using fiber-reinforced cementitious matrix (FRCM) composite systems.” *AC434*.

285 Italian Building Code (2008). “DM 14.01.2008: Norme tecniche per le costruzioni.” *Rome:*
286 *Italian Ministry of Infrastructures and Transportation*.

287 Kim, J. K. and Eo, S. (1990). “Size effect in concrete specimens with dissimilar initial cracks.”
288 *Magazine of Concrete Research*, 42(153), 233–238.

289 Lanzoni, L., Nobili, A., and Tarantino, A. (2012). “Performance evaluation of a
290 polypropylene-based draw-wired fibre for concrete structures.” *Construction and Build-*
291 *ing Materials*, 28(1), 798–806.

292 Loreto, G., Leardini, L., Arboleda, D., and Nanni, A. (2013). “Performance of RC slab-type
293 elements strengthened with fabric-reinforced cementitious-matrix composites.” *Journal of*
294 *Composites for Construction*, 18(3), A4013003.

295 Mouring, S. E., Barton, O., and Simmons, D. (2001). “Reinforced concrete beams externally
296 retrofitted with advanced composites.” *Advanced Composite Materials*, 10(2-3), 139–146.

297 Neville, A. M. and Brooks, J. J. (1987). *Concrete technology*. Longman Scientific & Technical.

298 Nobili, A. (2016). “Durability assessment of impregnated glass fabric reinforced cementitious
299 matrix (GFRCM) composites in the alkaline and saline environments.” *Construction and*
300 *Building Materials*, 105, 465–471.

301 Nobili, A., Lanzoni, L., and Tarantino, A. (2013). “Experimental investigation and monitor-
302 ing of a polypropylene-based fiber reinforced concrete road pavement.” *Construction and*
303 *Building Materials*, 47, 888–895.

304 Norris, T., Saadatmanesh, H., and Ehsani, M. R. (1997). “Shear and flexural strengthening
305 of RC beams with carbon fiber sheets.” *Journal of structural engineering*, 123(7), 903–911.

306 Ombres, L. (2011a). “Flexural analysis of reinforced concrete beams strengthened with a
307 cement based high strength composite material.” *Composite Structures*, 94(1), 143–155.

308 Ombres, L. (2011b). “Structural performances of PBO FRCM-strengthened RC beams.”
309 *Proceedings of the ICE-Structures and Buildings*, 164(4), 265–272.

310 Rahimi, H. and Hutchinson, A. (2001). “Concrete beams strengthened with externally
311 bonded FRP plates.” *Journal of composites for construction*, 5(1), 44–56.

312 RILEM, T. (1994). “RC 5 Bond test for reinforcement steel. 1. Beam test, 1982.” *RILEM*
313 *Recommendations for the Testing and Use of Constructions Materials*, 213–217.

314 Saadatmanesh, H. and Ehsani, M. R. (1991). “RC beams strengthened with GFRP plates.
315 I: Experimental study.” *Journal of Structural Engineering*, 117(11), 3417–3433.

316 Tertulliani, A., Arcoraci, L., Berardi, M., Bernardini, F., Brizuela, B., Castellano, C.,
317 Del Mese, S., Ercolani, E., Graziani, L., Maramai, A., et al. (2012). “The Emilia 2012
318 sequence: a macroseismic survey.” *Annals of Geophysics*, 55(4).

319 Toutanji, H. and Deng, Y. (2007). “Comparison between organic and inorganic matrices for
320 RC beams strengthened with carbon fiber sheets.” *Journal of Composites for Construction*,
321 11(5), 507–513.

322 Triantafillou, T. C. and Papanicolaou, C. G. (2005). “Textile reinforced mortars (TRM)
323 versus fiber reinforced polymers (FRP) as strengthening materials of concrete structures.”
324 *Proceedings of the 7th ACI International Symposium on Fibre-Reinforced (FRP) Polymer*
325 *Reinforcement for Concrete Structures*, American Concrete Institute, 99–118.

326
327
328
329
330
331
332
333

List of Tables

1	Mortars properties	15
2	Fabric properties in the principal direction	16
3	Cross-section inertial properties	17
4	Parameters for the evaluation of the optimal bonded length l_e	18
5	Compression results	19
6	Beam test results; FM=Failure mechanism: (c) cohesive in the brick layer, (t) traction in the concrete, (d) delamination at the fabric/matrix interface . . .	20

Characteristic	Unit	Value
Mean compression strength after 28 days	MPa	6.5
Mean flexural strength after 28 days	MPa	3
Support adhesion strength after 28 day	MPa	1
Water content	%	23
Aggregate maximum size	mm	0.7
Longitudinal elastic modulus	GPa	11
Water vapor permeability, μ	-	12

TABLE 1. Mortars properties

Characteristic	Unit	Value
Density	g/cm ²	160
Elastic modulus, E_f	GPa	210
Ultimate strength, f_{uf}	GPa	≥ 2.0
Ultimate strain, ϵ_{uf}	%	≥ 2.1
Cross-section area/unit width	mm ² /cm	0.88

TABLE 2. Fabric properties in the principal direction

Inertial property	Unit	Value
Area, A	mm^2	19500
Center of mass, x_G	mm	0
Center of mass, y_G	mm	119
Principal moment of inertia, I_{x_G}	mm^4	12391
Principal moment of inertia, I_{y_G}	mm^4	1358

TABLE 3. Cross-section inertial properties

Parameter	Unit	Value
γ_{rd}	-	1.25
k_b	-	1
k_G	-	0.037
FC	-	1.2
Γ_{fk}	N mm ⁻²	0.118
f_{bd}	N mm ⁻³	2.36
s_u	mm	0.1

TABLE 4. Parameters for the evaluation of the optimal bonded length l_e

Core	Cylinder strength [MPa]		
	Raw	Adjusted	
		(Kim and Eo 1990)	(Benjamin and Cornell 1970)
C1	9.89	10.78	10.81
C2	8.48	9.34	9.26
C3	8.00	8.75	8.75
C4	10.36	11.28	11.32
mean	9.18	10.03	10.03
std. dev.	1.12	1.18	1.22
rel.std. dev. [%]	12.20	11.83	12.20

TABLE 5. Compression results

Specimen	FM	Cycle	M_u [kNm]	N_u [kN]	τ_{av} [MPa]	τ_{av} mean [MPa]	Std.dev [MPa]
A1	c	A	7.11	33.88	0.86	0.88	0.02
A2	c+t	A	7.25	34.56	0.88		
A3	c	A	7.4	35.25	0.90		
A4	d	B	5.4	25.74	0.66	0.57	0.08
A5	d	B	4.02	19.16	0.49		
A6	d	B	4.27	20.35	0.52		
A7	d	B	5.09	24.26	0.62		

TABLE 6. Beam test results; FM=Failure mechanism: (c) cohesive in the brick layer, (t) traction in the concrete, (d) delamination at the fabric/matrix interface

334	List of Figures	
335	1	Roof system at ground floor for the hospital main building (H1) 22
336	2	Roof typical cross-section (dimensions in mm) 23
337	3	Application of the liquid impregnation agent to the cut-to-size carbon fabric:
338		(a) impregnation through immersion (Cycle A), (b) application with a brush
339		to the carbon fabric already placed on the mortar bed (Cycle B) 24
340	4	The roof concrete beam is placed upside down for lamination (clay tile on top,
341		steel hinge for the beam test at the bottom) 25
342	5	Concrete beam mid-span (a) and beam end (b) cross-sections (clay tile at the
343		bottom) and reference system 26
344	6	Schematic of a beam test: $l_F = 300$ mm, $l_A = 900$ mm 27
345	7	Beam test results - solid curves belong to Cycle A, dashed curves to Cycle B 28
346	8	Failure modes: cohesive fracture (specimen A1 and A3), tensile failure in the
347		concrete (A2), delamination (A4,A5,A7) 29
348	9	Location of the reference lines L and R (a) and their axial displacement w vs.
349		cross-sectional height y at 100% (solid) and at 60% (dashed) of the ultimate
350		load for specimen A2 (b). Reference system as in Fig.5 30
351	10	Ultimate load N and one-standard deviation bar 31

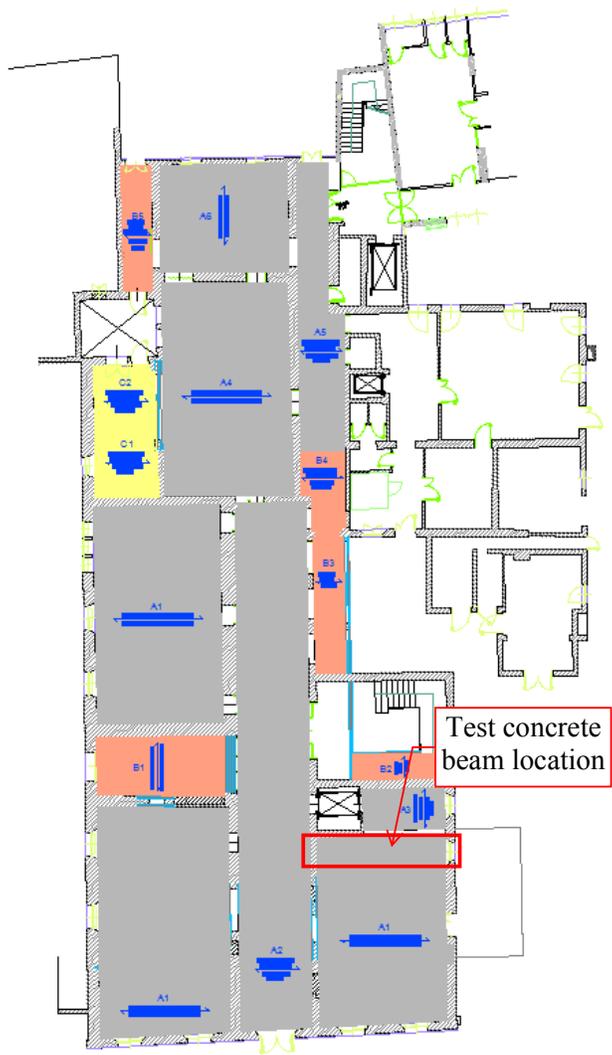


FIG. 1. Roof system at ground floor for the hospital main building (H1)

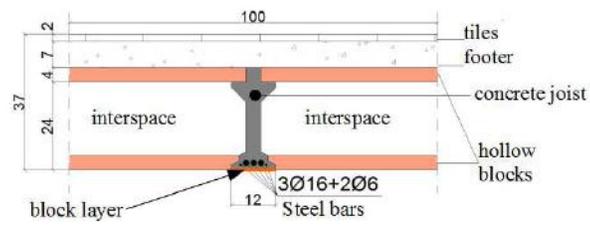


FIG. 2. Roof typical cross-section (dimensions in mm)



(a)

(b)

FIG. 3. Application of the liquid impregnation agent to the cut-to-size carbon fabric: (a) impregnation through immersion (Cycle A), (b) application with a brush to the carbon fabric already placed on the mortar bed (Cycle B)

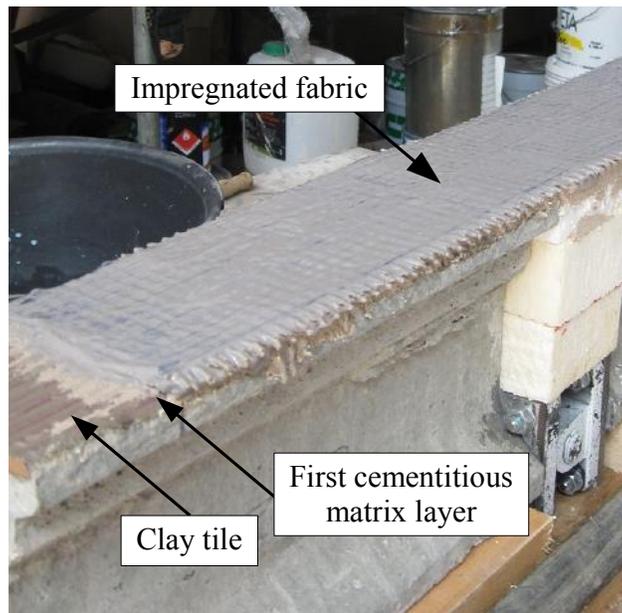


FIG. 4. The roof concrete beam is placed upside down for lamination (clay tile on top, steel hinge for the beam test at the bottom)

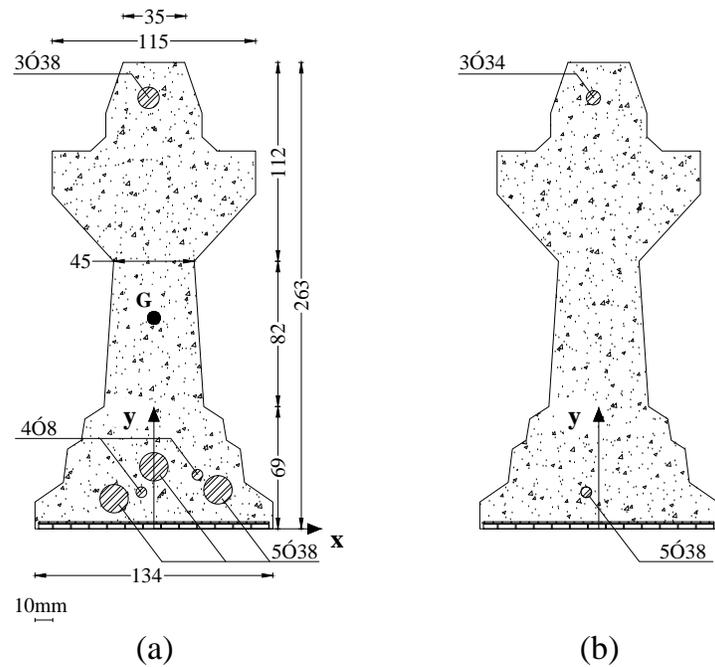


FIG. 5. Concrete beam mid-span (a) and beam end (b) cross-sections (clay tile at the bottom) and reference system

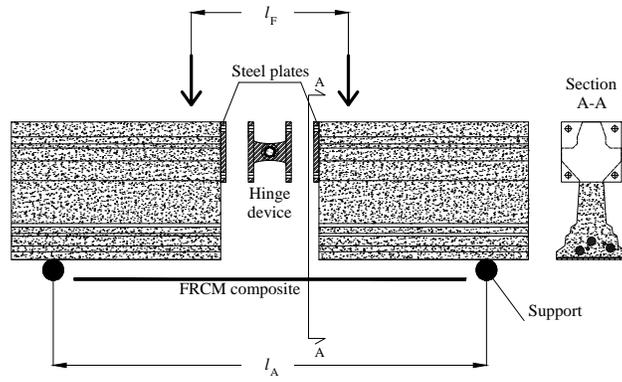


FIG. 6. Schematic of a beam test: $l_F = 300$ mm, $l_A = 900$ mm

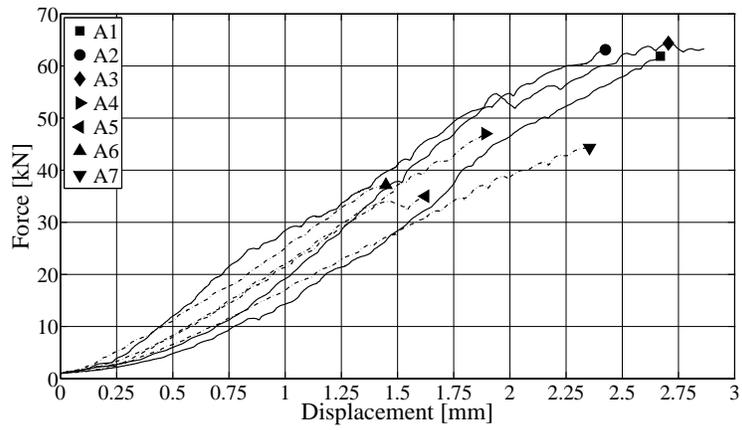


FIG. 7. Beam test results - solid curves belong to Cycle A, dashed curves to Cycle B



FIG. 8. Failure modes: cohesive fracture (specimen A1 and A3), tensile failure in the concrete (A2), delamination (A4,A5,A7)

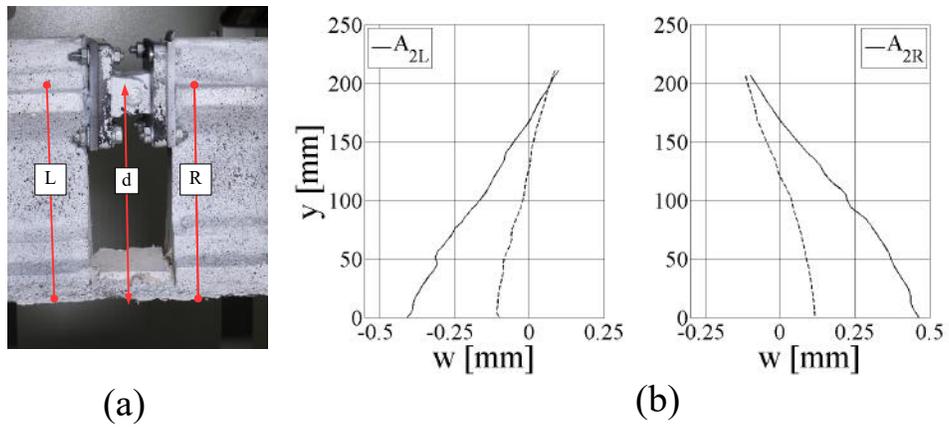


FIG. 9. Location of the reference lines L and R (a) and their axial displacement w vs. cross-sectional height y at 100% (solid) and at 60% (dashed) of the ultimate load for specimen A2 (b). Reference system as in Fig.5

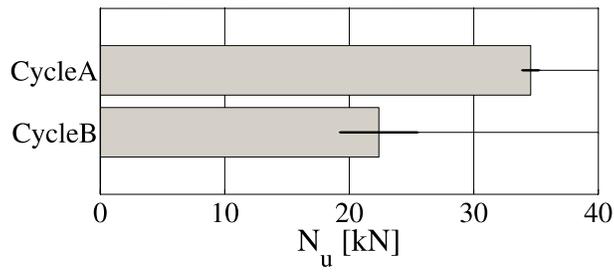


FIG. 10. Ultimate load N and one-standard deviation bar